



Intelligent Mains Switching Input/Output Unit Installation Guide

Part No	Product Name
SA4700-103APO	Intelligent Mains Switching Input/Output Unit

Technical Information

All data is supplied subject to change without notice. Specifications are typical at 24V, 25°C and 50% RH unless otherwise stated.

> Supply Voltage 17-35V dc Quiescent Current 700µA Power-up Surge Current 1.1mA

Relay Output Contact Rating 5A at 30V dc or 250V ac

LED Current 1.6mA per LED

Maximum Loop Current 1A

(I_max; L1 in/out)

Operating Temperature -40°C to 70°C

Humidity 0% to 95% RH

(no condensation or icing)

Approvals EN 54-17 & EN 54-18


For additional technical information please refer to the following documents which are available on request.


PP2556 - Intelligent Mains Switching Input/Output Unit





DANGER! ELECTRIC SHOCK!


This label indicates the risk of hazardous voltage and electric shock which will cause death, serious injury, or substantial damage. Turn off power supplying this device before working inside.



























Addressing

Table 1

		XP95 / Discovery Systems	CoreProtocol Systems
	1		
3			
-	4	Sets the address	Sets the address
en	5		
Segment 5			
Sei	7		
-	8	Set to '0' (Fault value is returned if set to '1')	
	FS	Enables failsafe mode (compliant with BS7273-4 for door holders)	Enables failsafe mode (compliant with B\$7273-4 for door holders)
	LED	Enables/Disables LED (except Isolator LED)	Enables/Disables LED (except Isolator LED)

Note: On mixed systems addresses 127 and 128 are reserved. Refer to system's panel manufacturer for further information.


Address Setting Examples















Connectivity Examples

Fig. 1 Standard resistive monitoring mode

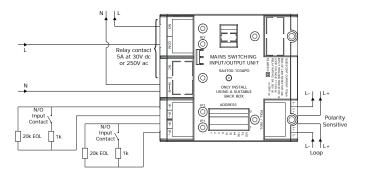


Fig. 2 Normally open and normally closed contact monitoring mode (compatible with CoreProtocol only)


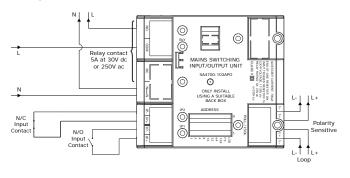


Fig. 3 Class A Zone monitoring mode (Compatible with CoreProtocol only)

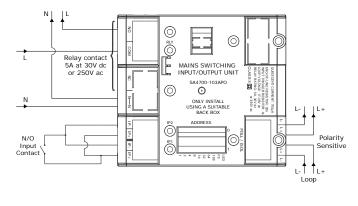

Caution

The Mains Switching Input/Output Unit is not designed for outdoor use unless if is mounted in a suitable weather proof enclosure. It is designed to switch voltages of up to 250V and should be installed with all due care by a qualified person. Isolate mains supply before starting work. This equipment is not suitable for use in locations where children are likely to be present.

LED Status Indicator

DIV	Continuous Red	Relay Active
RLY	Continuous Yellow	Fault
POLL/	Flashing Green	Device Polled
ISO	Continuous Yellow	Isolator Active
IP	Continuous Red	Input Active
IP IP	Continuous Yellow	Input Fault

Note:

Not all LEDs can be on simultaneously.

Commissioning

The installation must conform to BS5839–1 (or applicable local codes). This product is to be installed in an area accessible only to skilled persons and instructed persons with the proper authorisation.

Maintenance

Removal of the external cover must be carried out using a flat screwdriver or similar tool.

Troubleshooting

Before investigating individual units for faults, it is important to check that the system wiring is fault free. Earth faults on data loops or interface zone wiring may cause communication errors. Many fault conditions are the result of simple wiring errors. Check all connections to the unit.

Problem Possible Cause

No response or missing
Fault condition reported
Relay fails to operate

Analogue value unstable
Constant Alarm

Incorrect address setting Incorrect loop wiring Incorrect input wiring Incorrect end-of-line resistor fitted Incorrect wiring Control panel has incorrect cause and effect programming Dual address Loop data fault, data corruption

Incom Isolator LED on Short-

Incorrect wiring Incorrect end-of-line resistor fitted Incompotible control panel software Short-circuit on loop wiring Wiring reverse polarity Too many devices between isolators

Mode Table*

Mode	Description
1	DIL Switch XP Mode
2	Alarm Delays
3	Output and N/O input (can be equivalent for Output only)
4	Output and N/C input
5	Output with Feedback (1st input N/C, 2nd input N/O)
6	Failsafe Output with Feedback (1st input N/C, 2nd input N/O)
7	Failsafe Output without Feedback
8	Momentary Input Activation Sets Output Relay
9	Input Activation Sets Output

*CoreProtocol enabled systems only

© Apollo Fire Detectors Limited 2016 Apollo Fire Detectors Limited, 36 Brookside Road, Havant, Hampshire, PO9 1 JR, UK

Tel: +44 (0) 23 9249 2412 Fax: +44 (0) 23 9249 2754 Email: techsalesemails@apollo-fire.com Website: www.apollo-fire.co.uk