



SOCKET UNION

(ABS003 - 27mm)

Used for breaking a section of aspirating smoke detection pipe network for maintenance purposes. This device is designed for aspirating fire detection only.




Installation Instructions:

- Use the correct solvent Plusbond 3019.
- Do not paint.
- Keep pipe clean and free from dust.
- Do not install in direct sunlight.
- Only install with approved pipe.
- Do not use solvents to clean, only soapy water.
- Do not over tighten.
- Keep O'Ring in place.
- Ensure that the socket union locks into position when tightening.


Part No. ABS003 - 27mm
Pipe colour RED
Diameter Tolerance +/- 0.15mm



Side Elevation Dissection

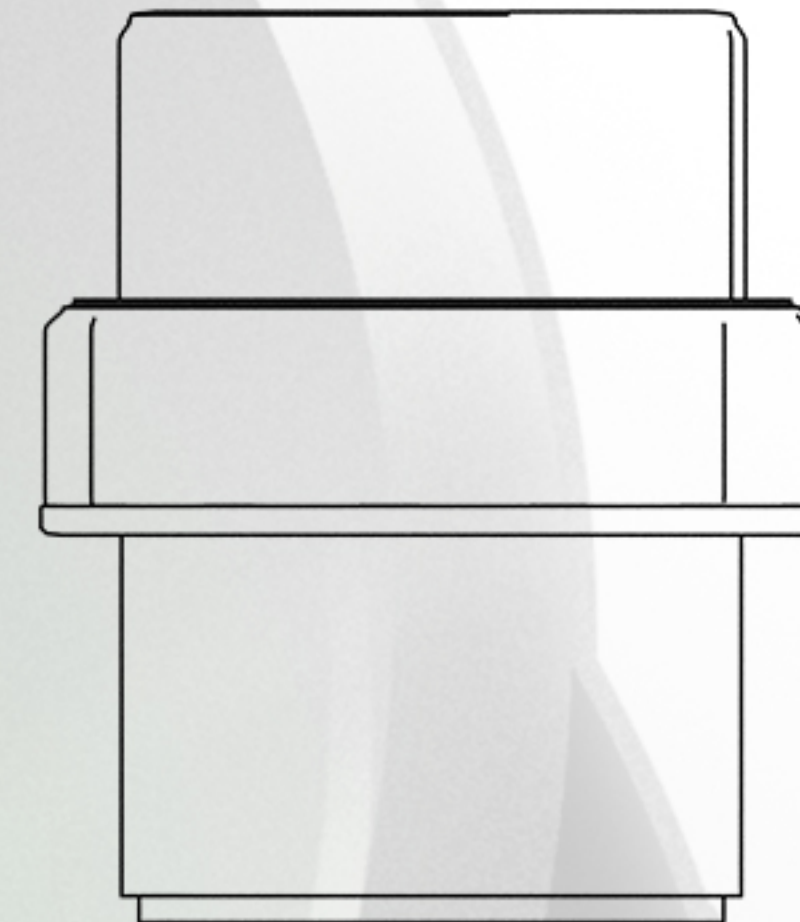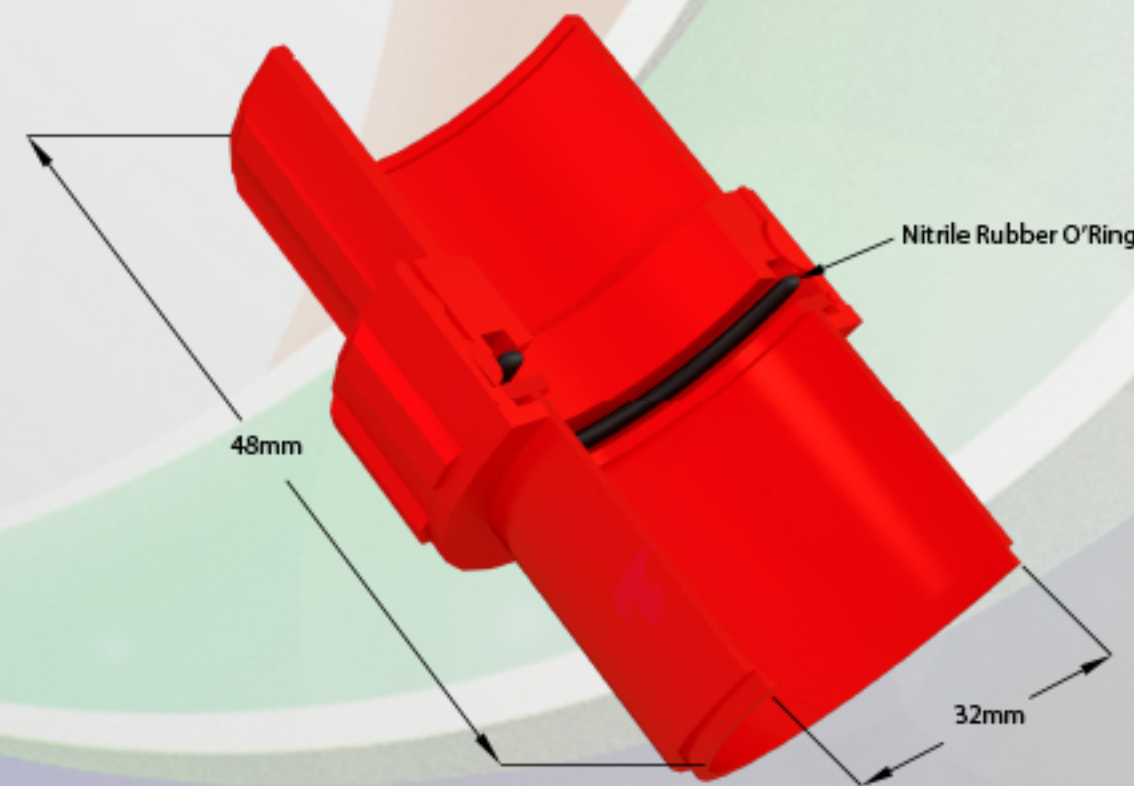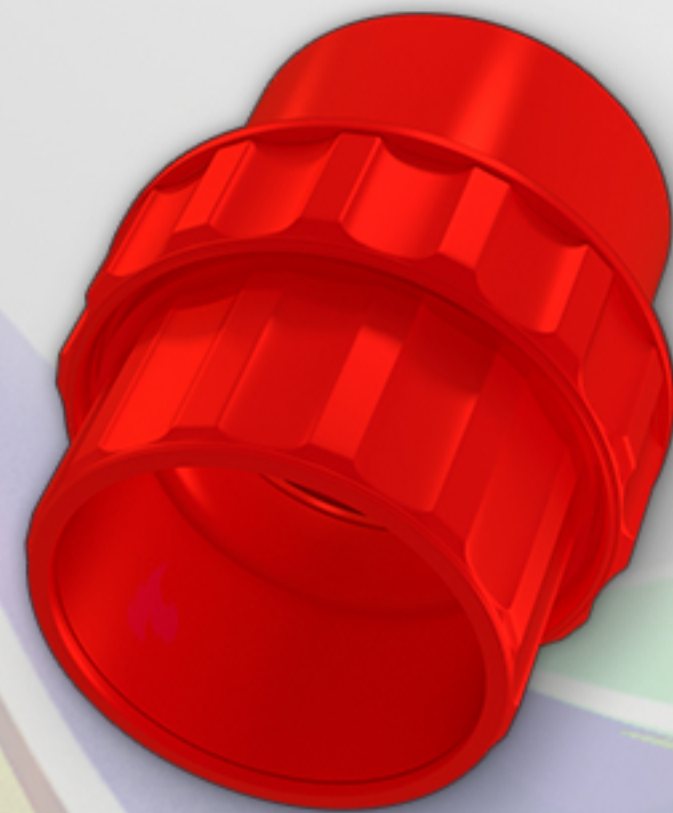

Front Elevation

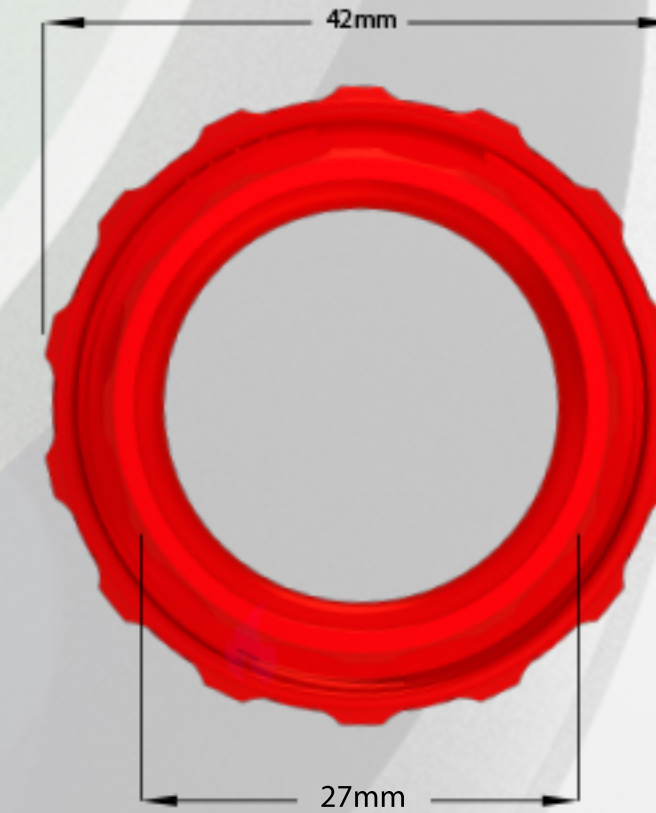

RAW MATERIAL DATA

Kumho ABS 750
 Acrylonitrile Butadiene Styrene

Physical:
 Specific Gravity 1.04
 Test Method ASTM D792

Melt Mass - Flow Rate (MFR)
 200°C/21.6 kg 47 g/10 min
 200°C/5.0 kg 4.1 g/10 min
 220°C/10.0 kg 34 g/10 min
 Test Method ASTM D1238

Molding Shrinkage -
 Flow 0.0040 to 0.0070 in/in
 Test Method ASTM D955

Mechanical:
 Tensile Strength
 Yield, 73°F (23°C)
 1.97 in (50.0mm)
 6670 psi
 Test Method ASTM D638

Tensile Elongation
 Yield, 73°F (23°C)
 1.97 in (50.0 mm), 15%
 Test Method ASTM D638

Flexural Modulus
 Yield, 73°F (23°C)
 0.118 in (3.00 mm)
 312000 psi
 Test Method ASTM D638

Flexural Strength
 Yield, 73°F (23°C)
 0.118 in (3.00 mm)
 9230 psi
 Test Method ASTM D790

Impact
 Notched Izod Impact
 73°F(23°C), 0.126 in (3.20 mm), 5.5 ft-lb/in
 73°F(23°C), 0.252 in (6.40 mm), 4.8 ft-lb/in
 Test Method ASTM D256

Hardness
 Rockwell Hardness (R-Scale) 108
 Test Method ASTM D785

Thermal
 Deflection Temperature Under Load
 264 psi (1.8 MPa), Unanneald 185°F/85°C
 Test Method ASTM D648

Vicat Softening Temperature 203°F/95°C
 Test Method ASTM D1525

Flamability
 Flame Rating
 0.0630 in (1.60 mm) HB
 0.0866 in (2.20 mm) HB
 0.126 in (3.20 mm) HB
 Test Method UL 94

Bisson Ltd
 Unit 11, Eldonwall Trading Estate,
 St.Phillips, Bristol, BS4 3QQ

Tel: 0117-967-9999
Fax: 0117-961-9261
<http://www.abspipesandfittings.co.uk>